

LED Emergency Luminaries






LED Twin Spot Recess Mount Emergency Light

Surface / Recess Mounted Model: **SLEL-02**

Monthly Self-Test Function




COVER DIMENTION: L360 x W170 mm, BOX DIMENSION: L322 x H63 x W141 mm

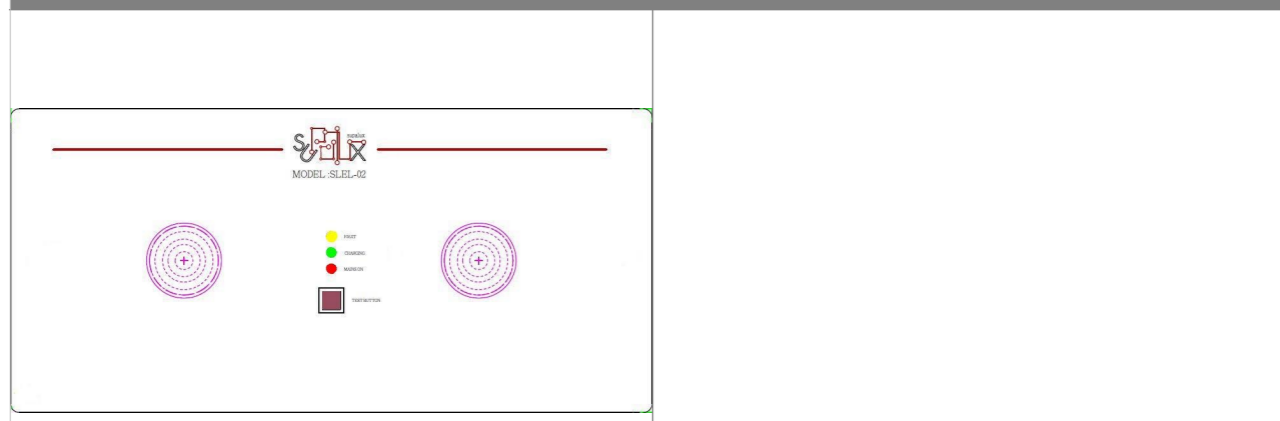

SPECIFICATION

| Model No. | SLEL-02 |
|--|--|
| Installation Mode | Surface / Recess |
| Luminaries Type | Non-Maintained Type |
| Light Source | 2 x 3W High Quality LED chips |
| Housing | Powder-coated Mild Steel |
| Input Voltage | AC 180V-242V, 50Hz |
| Rechargeable Battery | NiMH 12V 1800mAh |
| Total Power Consumption | 6W |
| Battery Recharge Duration | ≤ 12 hours |
| Emergency Duration | ≥ 3 Hours |
| Insulation Class | Class one Earthing |
| Operation Temperature | 0°C~50°C |
| LED Operating Life | ≥ 50000 Hours |
| Battery Charge and Discharge Life Span | Approx. 4 year |
| Outside Features | "Red" "Yellow" "Green" indication light & "Test" switch |
| Test Button | Press type |
| LED Indicators | "Green" LED "Flashing" Charging "Green" LED "ON" Fully Charge "Yellow" LED "Flashing" Battery / Lamp Fault "Red , Green ,Yellow" LED"ON" Self-test Fault "Red" LED "ON" Main "Red" LED" Flashing indicating self-testing |
| Self-Test Function | <ul style="list-style-type: none"> • System timer will start to count once the mains power is connected. • Self-Testing will work automatically on every 30 Days. • RED LED indicator will be flashing during self-testing. • Time schedule for the battery discharging is follow FSD PPA 104(A) 4th Revision as below: - Monthly: Not exceeding one quarter of rated duration |
| Testing Standard | HKFSD Codes of Practice for minimum service installations and equipments *FSD PPA 104(A) 4th Revision *BSEN 60598-2-22:2008, *BS 5266-1:2012 |

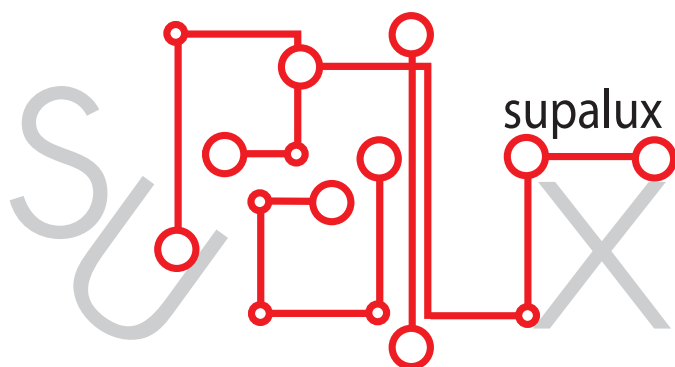**Web Site**

<http://www.sl-led-application.com>

E-mail

info@sl-led-application.com

Tel

852 – 2370 9394

Fax

852 – 2743 1123

Address

Unit 202A, 20/F., Tak King Industrial Building,
27 Cheung Lee Street, Chai Wan, Hong Kong.

Editor

Au Pui Man
(openopw@gmail.com)