

LED Emergency Luminaries






LED Twin Spot Surface Mount Luminaires

Surface Mount Model: **SLEL-06**


Monthly Self-Test Function



BOX DIMENSION: L323.4 x H63 x W141.4 mm

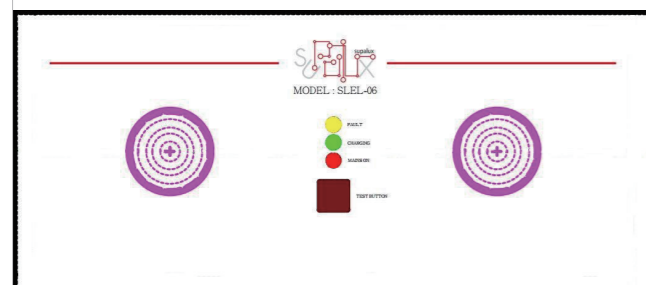

| SPECIFICATION | |
|--|--|
| Model No. | SLEL-06 |
| Installation Mode | Surface |
| Luminaires Type | Non-Maintained Type |
| Light Source | 2 x 3W High Quality LED chips |
| Housing | Powder-coated Mild Steel |
| Input Voltage | AC 180V–242V, 50Hz |
| Rechargeable Battery | NiMH 12V 1800mAh |
| Total Power Consumption | 6W |
| Battery Recharge Duration | ≤ 12 hours / 24 hours |
| Emergency Duration | ≥ 2 hours / 3 Hours |
| Insulation Class | Class one Earthing |
| Operation Temperature | 0°C~50°C |
| LED Operating Life | ≥ 50000 Hours |
| Battery Charge and Discharge Life Span | Approx. 4 year |
| Outside Features | "Red" "Yellow" "Green" indication light & "Test" switch |
| Test Button | Press type |
| LED Indicators | <ul style="list-style-type: none"> "Green" LED "Flashing" Charging "Green" LED "ON" Fully Charge "Yellow" LED "Flashing" Battery / Lamp Fault "Red , Green , Yellow" LED"ON" Self-test Fault "Red" LED "ON" Main "Red" LED" Flashing indicating self-testing |
| Self-Test Function | <ul style="list-style-type: none"> • System timer will start to count once the mains power is connected. • Self-Testing will work automatically on every 30 Days. • RED LED indicator will be flashing during self-testing. • Time schedule for the battery discharging is follow FSD PPA 104(A) 4th Revision as below: - Monthly: Not exceeding one quarter of rated duration |
| Testing Standard | <p>HKFSD Codes of Practice for minimum service installations and equipments</p> <p>*FSD PPA 104(A) 4th Revision</p> <p>*BSEN 60598-2-22:2008,</p> <p>*BS 5266-1:2012</p> |

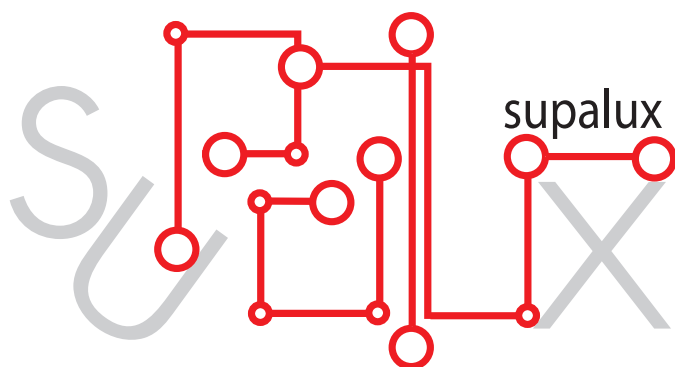

Web Site

<http://www.sl-led-application.com>

E-mail

info@sl-led-application.com

Tel

852 – 2370 9394

Fax

852 – 2743 1123

Address

Unit 202A, 20/F., Tak King Industrial Building,
27 Cheung Lee Street, Chai Wan, Hong Kong.

Editor

Au Pui Man
(openopw@gmail.com)